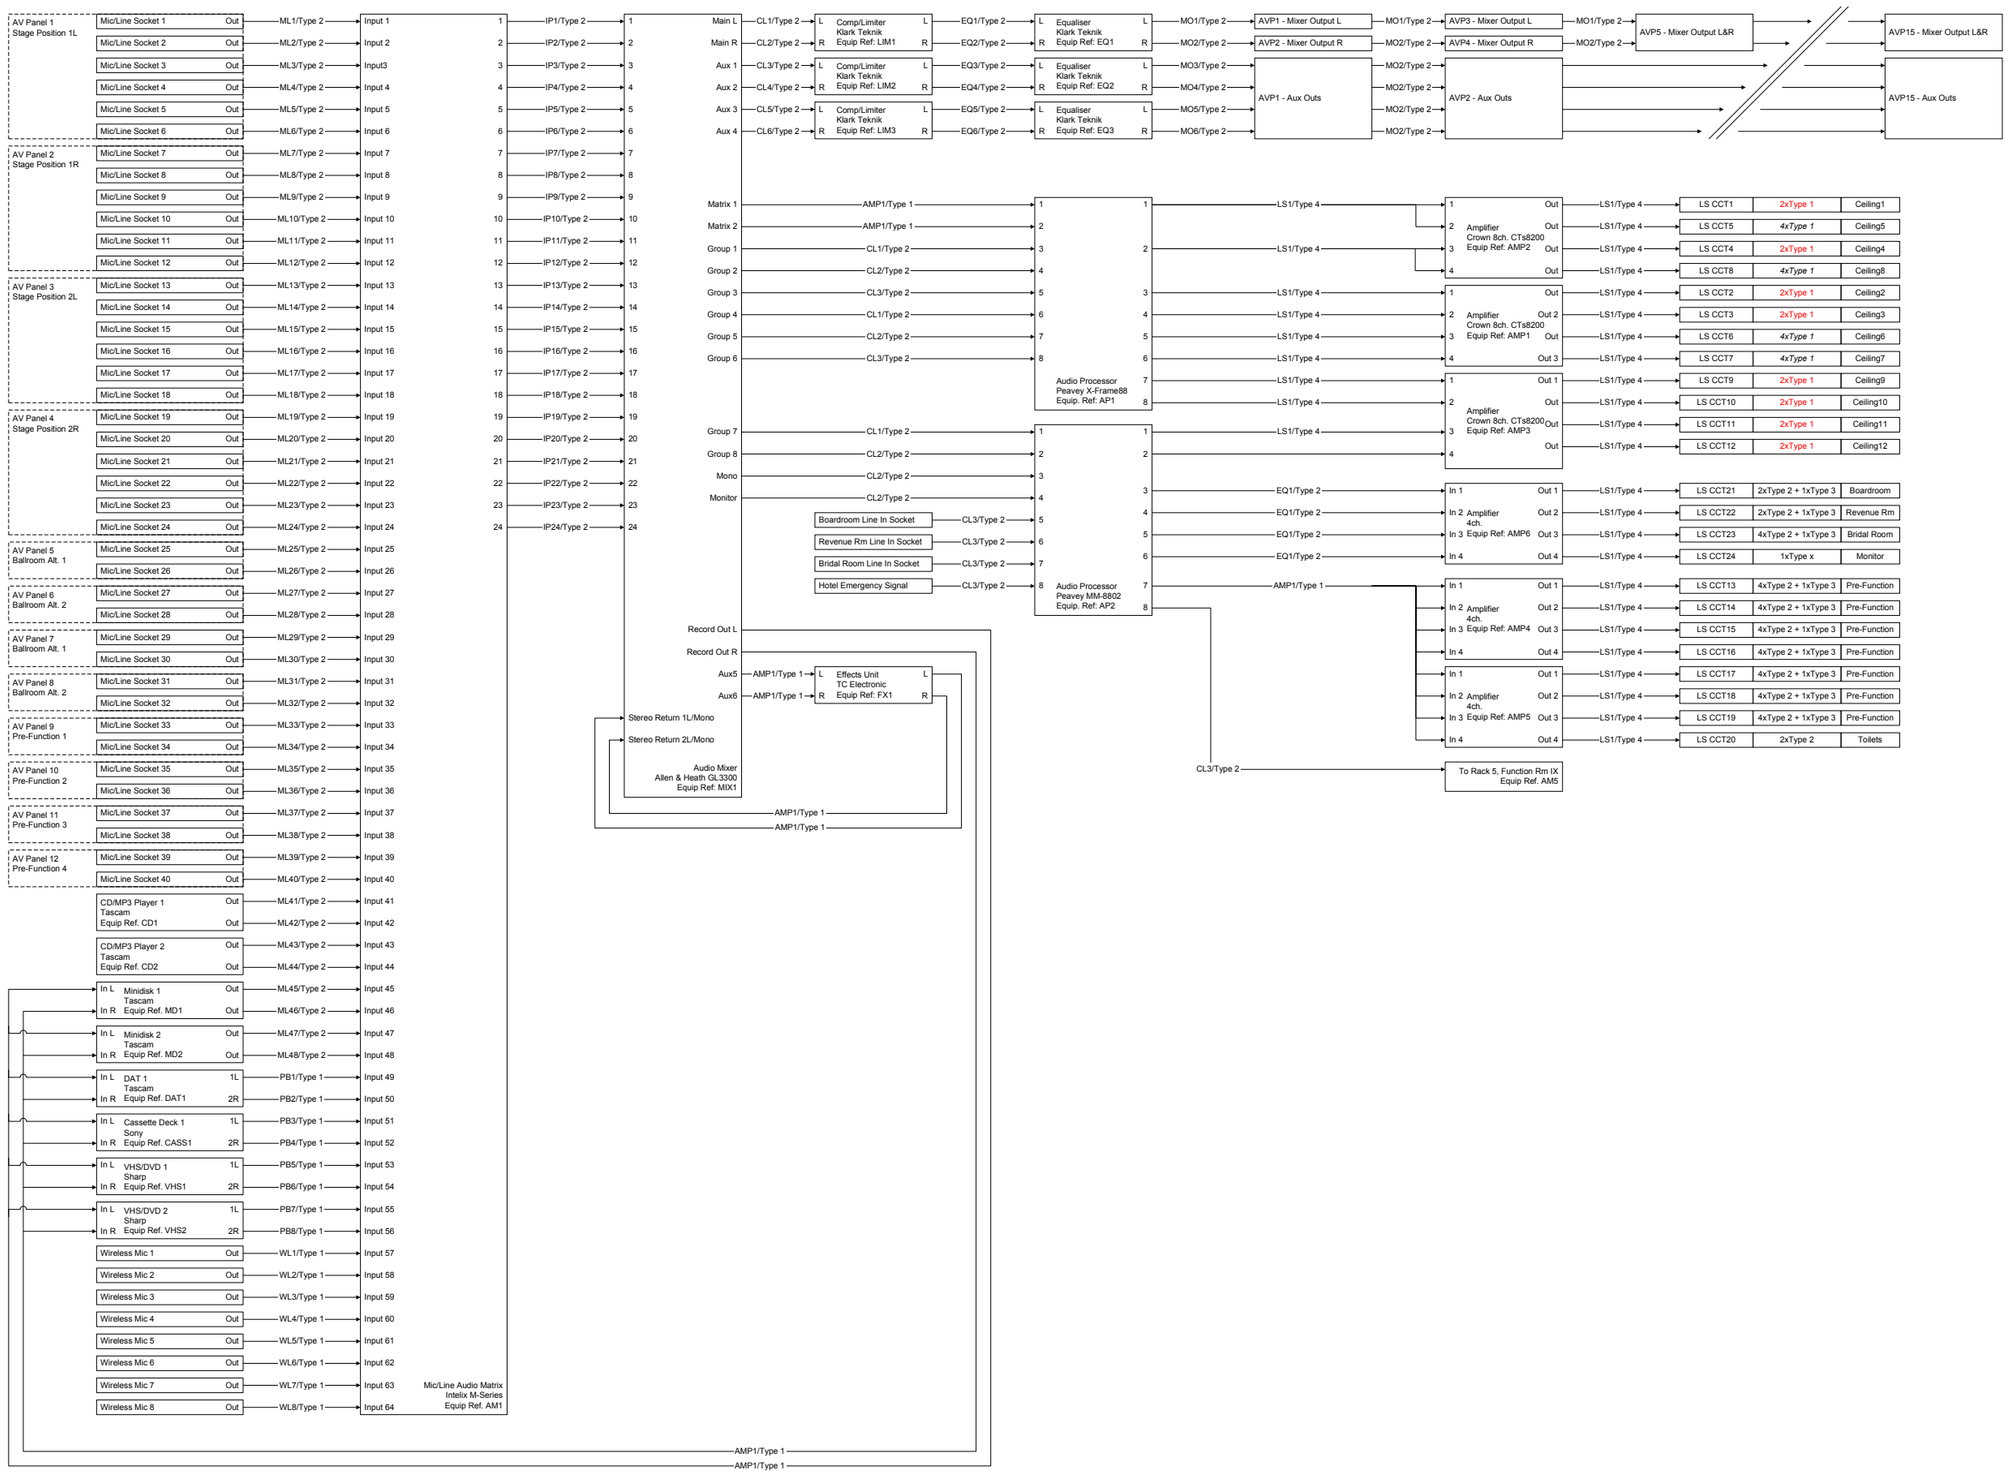

Rev	Date	Description
3	12/05/03	X-Frame Replaces Conventional Processing.
2	09/05/03	8 Wireless Inputs
1	08/05/02	Ancillary Room Inputs Added
0	05/05/03	Initial Release

Notes:

1) All cables shall be **clearly** labelled at **both** ends.

2) --

3) --

Project:

Intercontinental Hotel

Area:

Ballroom & Pre-Function

Drawing Title:

Audio Schematic

Unit 9, 6/F Tower 1
Harbour Centre
1 Hok Cheung Street
Hung Hom, Kowloon
Hong Kong

Tel (852) 2740 9741
Fax (852) 2783 0500
Email - nick@winkypro.com

Scale:	Initial Date:	Drawn By:
N/A	15/04/03	NS

Filename:	(yymmdd)_ICH_BR_AudioSchematic .vsd
Drawing No:	